


SINGLE PHASE 320 AMP UNDERGROUND SERVICE ENTRANCE

Northwestern Wisconsin Electric Company requirements:

320 AMP UL Approved Meter Socket With Lever Bypass

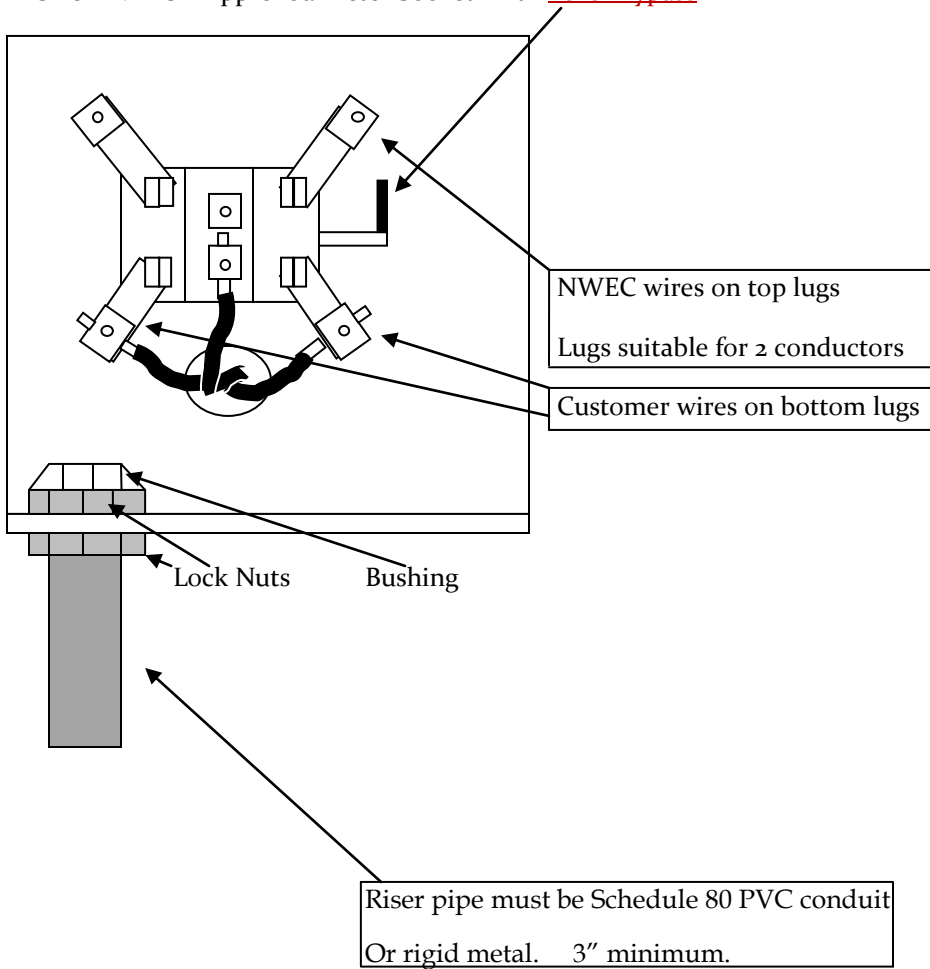

*ALL MATERIALS USED FOR THE METERING
ASSEMBLY ARE FURNISHED BY THE CUSTOMER

*ALL GROUNDING IS REQUIRED TO FOLLOW
NEC AND WISCONSIN REQUIREMENTS



**Northwestern
Wisconsin Electric Company**